


OCCUPANCY CLASSIFICATION:
UNIT A: C
UNIT B: C
FIRE RESISTANCE RATINGS:
FLOOR: 45 MIN. TABLE 9.10.8.1
WALL: 45 MIN. 9.10.9.14
MIN. SOUND CONTROL TRANSMISSION RATING:
BETWEEN DWELLING UNITS: MIN. BO 9.11.2.1(1)

ONTARIO BUILDING CODE DATA MATRIX PART 3 OR 9		
	PART 3	PART 9
1. PROJECT DESCRIPTION, RENOVATION	1.1(2.4)	9.10.3
2. NUMBER OF STOREYS, 2 ABOVE	4.1.2	9.10.4
3. NUMBER OF FACING STREETS, 1	3.10.2	9.10.2
4. BUILDING CLASSIFICATION, GROUP C	3.2.2(2)	9.10.2
5. BUILDING CLASSIFICATION, GROUP C	3.2.2(2)	9.10.2
6. STAIRCASE NOT REQUIRED	3.2.2(2)	9.10.5
7. FIRE ALARM NOT REQUIRED	3.2.4	9.10.5
8. WATER SERVICE ABSOLUTE	9.10.1	9.10.1
9. NOT A REAR BUILDING	9.10.1	9.10.1
10. ACTUAL CONSTRUCTION	3.2.2(2)	9.10.6
11. PERMITTED CONSTRUCTION	COMPLIANT AND NON-COMPLIANT	
12. EXISTING FIRE DESIGN	NO	
13. EXISTING FIRE DESIGN	NO	
14. REQUIRED FIRE RESISTANCE	45 MIN. 8B-3 ASSEMBLY NUMBER PFC	3.2.2(2)
15. REQUIRED FIRE RESISTANCE	45 MIN. 8B-3 ASSEMBLY NUMBER WHI	9.10.6
16. ROOF	0	


FIRST FLOOR CEILING/SECOND FLOOR FLOOR
FIRE/SOUND CONSTRUCTION ASSEMBLY
AS PER SUPPLEMENTARY STANDARD SB-3
ASSEMBLY * PFC: ABSORPTIVE MATERIAL IN CAVITY
RESILIENT MTL. CHANNEL SPACED AT 16" O/C
5/8" TYPE X GYPSUM BD.
FIRE RESISTANCE RATING: 1HR.
SOUND TRANSMISSION CLASS (STC): 54

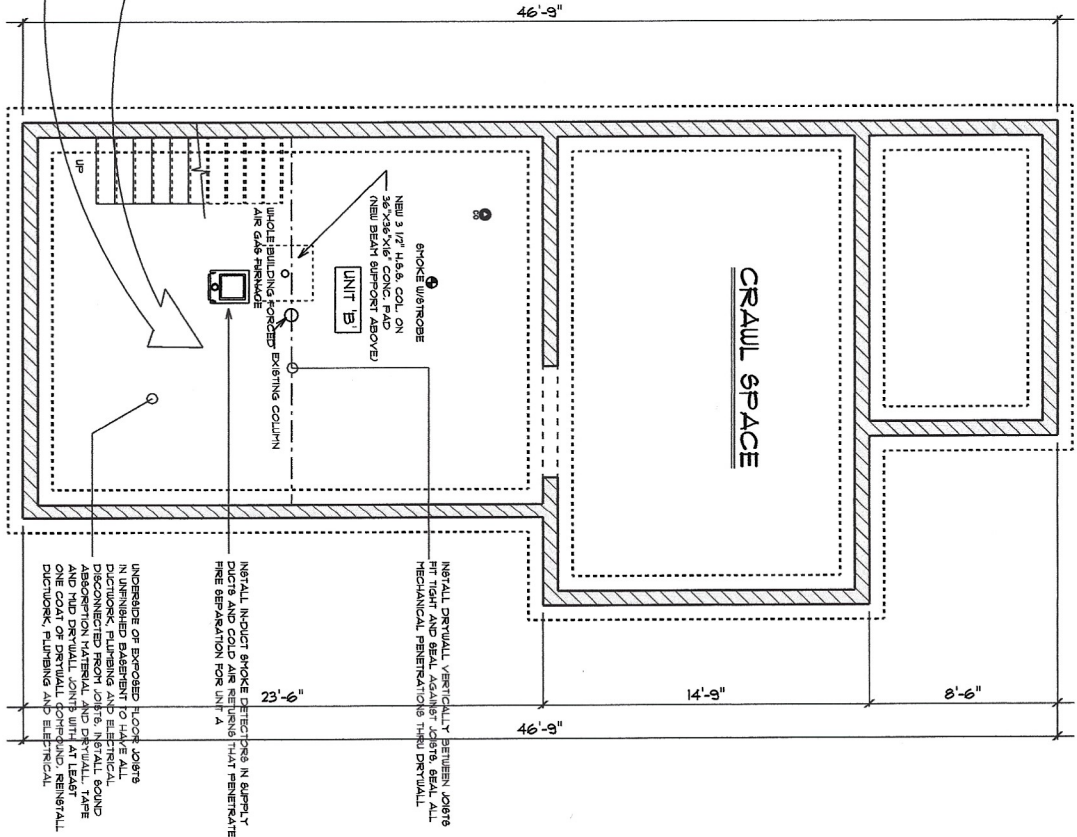

EXISTING BASEMENT PLAN

REVISED 07.11.2021

EXISTING MAIN FLOOR PLAN

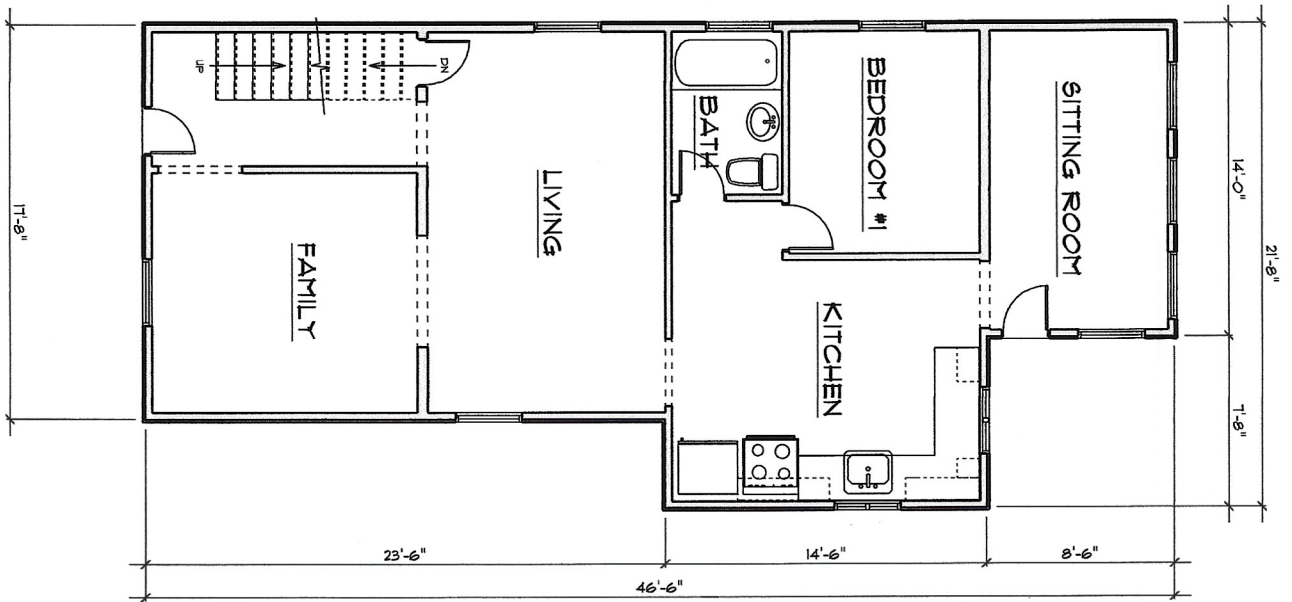


OCCUPANCY CLASSIFICATION:
 UNIT A: C
 UNIT B: C
 FIRE RESISTANCE RATINGS:
 FLOOR: 45 MIN. TABLE 9.10.8.1.
 WALL: 45 MIN. 9.10.9.14.
 MIN. SOUND CONTROL TRANSMISSION RATING:
 BETWEEN DWELLING UNITS: MIN. 50 9.1.2.1(1)

FIRST FLOOR CEILING/SECOND FLOOR FLOOR
 FIRE/SOUND CONSTRUCTION ASSEMBLY
 AS PER SUPPLEMENTARY STANDARD 9B-3
 ASSEMBLY * FSC ABSORPTIVE MATERIAL IN CAVITY
 RESILIENT MTL. CHANNEL SPACED AT 16" O/C
 5/8" TYPE X GYPSUM BD.
 FIRE RESISTANCE RATING: 1HR.
 SOUND TRANSMISSION CLASS (STC): 54


ONTARIO BUILDING CODE DATA TABLE PART 3 OR 9		
1. PROJECT DESCRIPTION, RENOVATION	PART 3	PART 9
2. NUMBER OF STOREYS, 2 ABOVE	1.12.1.1	9.10.1.3
3. NUMBER OF FACING STREETS, 1	1.12.1.2	9.10.1.4
4. BUILDING CLASSIFICATION, GROUP C	3.2.2.2.0	9.10.2.0
5. BUILDING TYPE, RESIDENTIAL	3.2.2.2.1	9.10.2.1
6. STAIRS, NOT REQUIRED	3.2.2.2.2	9.10.2.2
7. FIRE ALARM, NOT REQUIRED	3.2.2.2.3	9.10.2.3
8. WATER SERVICE, ADAPTABLE	3.2.2.2.4	9.10.2.4
9. NOT A LIGHT BUILDING	3.2.2.2.5	9.10.2.5
10. ACTUAL CONSTRUCTION, COMBUSTIBLE AND NON-COMBUSTIBLE	3.2.2.2.6	9.10.2.6
11. FIREZONING AREA	N/A	9.10.2.7
12. HAZARDOUS SUBSTANCE	NO	9.10.2.8
13. REQUIRED FIRE RESISTANCE	NO	9.10.2.9
14. REQUIRED FIRE RESISTANCE	NO	9.10.2.10

INSTALL DRYWALL VERTICALLY BETWEEN JOISTS
 FIT TIGHT AND SEAL AGAINST JOISTS. SEAL ALL
 MECHANICAL PENETRATIONS THRU DRYWALL


PROPOSED MAIN FLOOR PLAN

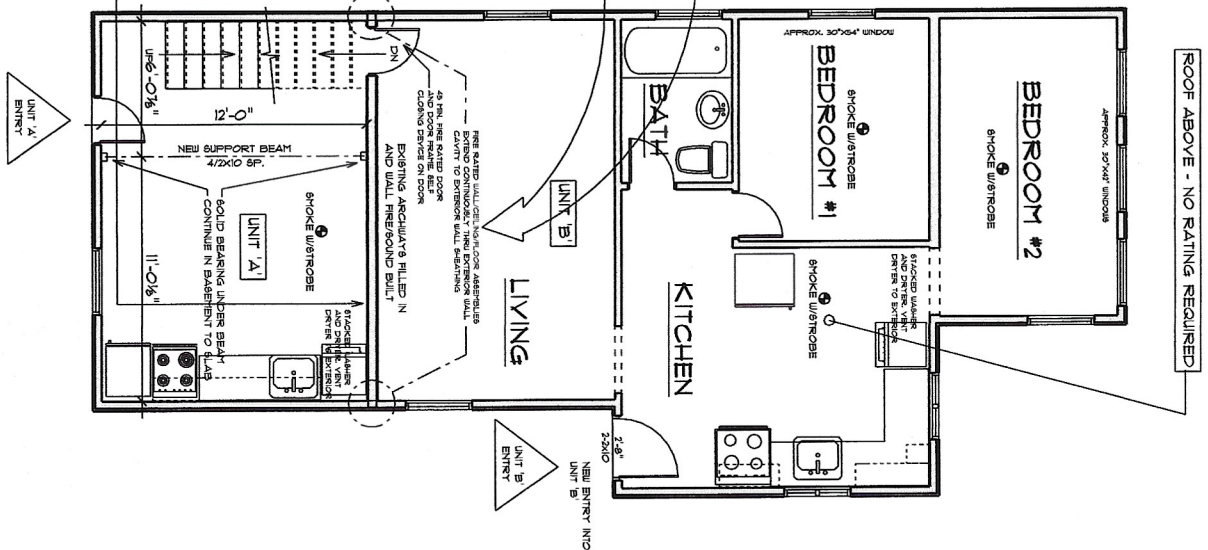

EXISTING SECOND FLOOR PLAN

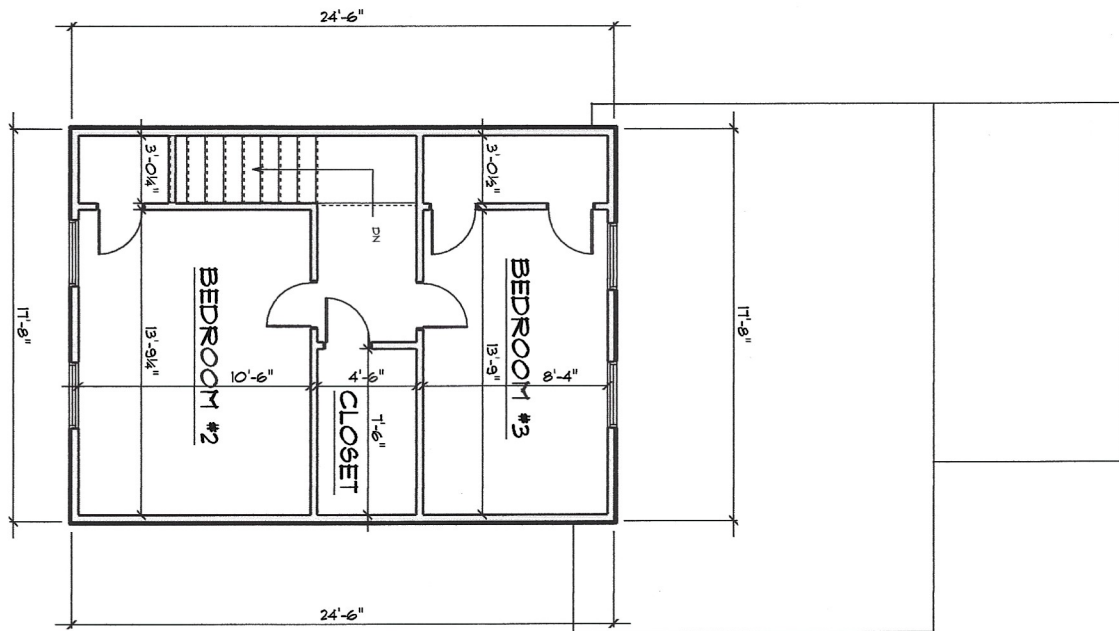

PROPOSED SECOND FLOOR PLAN

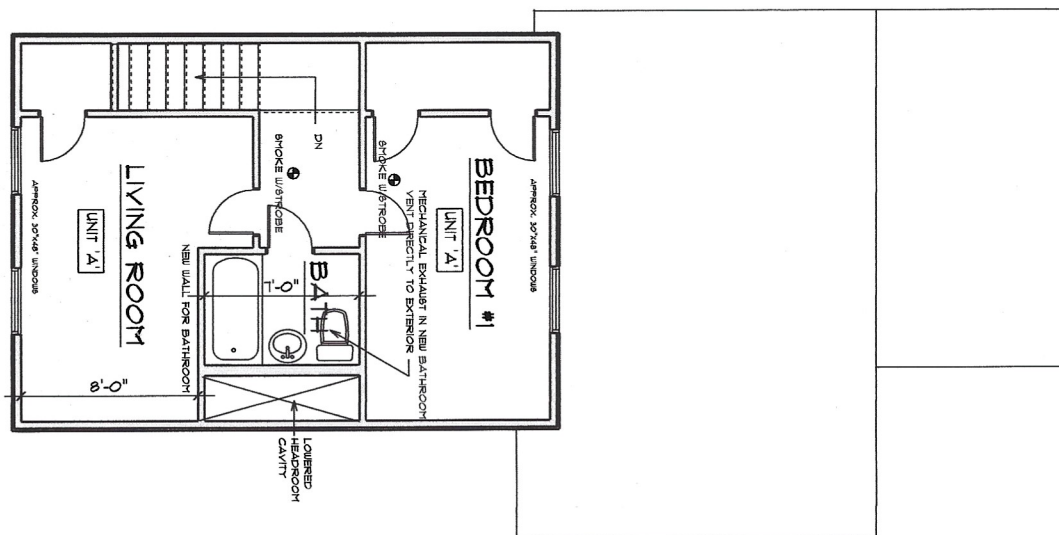


ONTARIO BUILDING CODE DATA MATRIX PART 3 OF 3

	PART 3	PART 3
1. PROJECT DESCRIPTION, RENOVATION	1.12.14.1	9.10.13
2. NUMBER OF STOREYS, 2 ABOVE	14.12	9.10.4
3. NUMBER OF FACING STOREYS, 1		9.10.20
4. BUILDING CLASSIFICATION, GROUP C	9.11.20	9.10.1
5. BUILDING CLASSIFICATION, GROUP C	9.11.20	9.10.2
6. STAIRCASE NOT REQUIRED	9.2.8	9.10.23
7. FIRE ALARM NOT REQUIRED	9.2.4	9.10.8
8. WATER SERVICE ADJUSTABLE	9.2.5.1	
9. NOT A HIGH BUILDING	9.2.6	
10. ACTUAL CONSTRUCTION	9.2.20	9.10.6
11. HAZARDOUS AREA	N/A	
12. HAZARDOUS FREE DESIGN	NO	
13. HAZARDOUS FREE DESIGN	NO	
14. REQUIRED FIRE RESISTANCE	48 MIN. 68-3 ASSEMBLY NUMBER 103	3.22.20
COMMON WALLS	48 MIN. 68-3 ASSEMBLY NUMBER 103	9.10.3
ROOF	0	

FIRST FLOOR CEILING/SECOND FLOOR FLOOR
FIRE/SOUND CONSTRUCTION ASSEMBLY
AS PER SUPPLEMENTARY STANDARD 9B-3
ASSEMBLY * P30: ABSORPTIVE MATERIAL IN CAVITY
RESILIENT MTL. CHANNEL SPACED AT 16" O/C
5/8" TYPE X GYPSUM BD.
FIRE RESISTANCE RATING: 1HR.
SOUND TRANSMISSION CLASS (STC): 54

INSTALL IN-DUCT SMOKE DETECTORS IN SUPPLY
DUCTS AND COLD AIR RETURNS THAT PENETRATE
FIRE SEPARATION FOR UNIT A

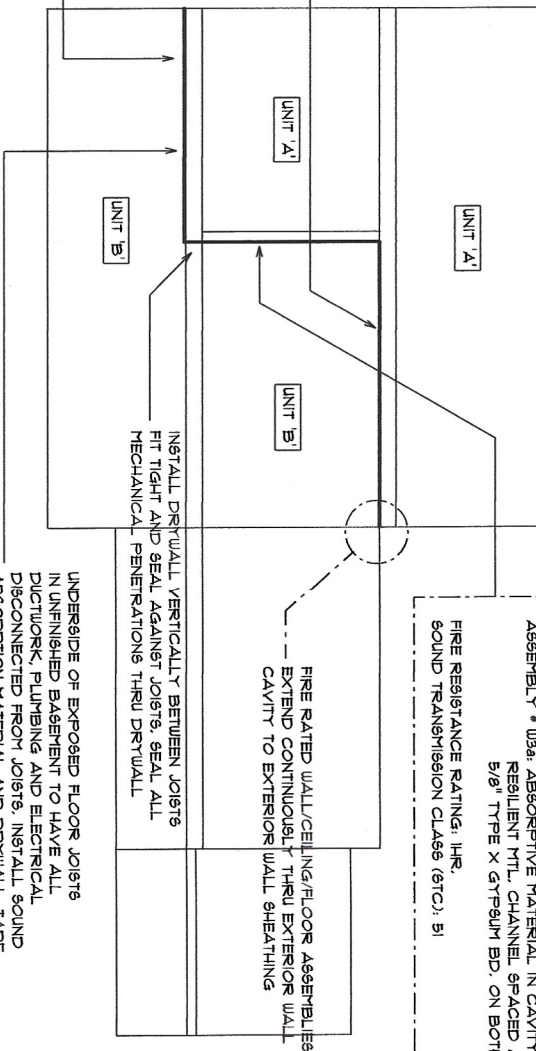

WOOD STUD WALL
FIRE/SOUND CONSTRUCTION ASSEMBLY
AS PER SUPPLEMENTARY STANDARD 9B-3
ASSEMBLY * U3a: ABSORPTIVE MATERIAL IN CAVITY
RESILIENT MTL. CHANNEL SPACED AT 16" O/C
5/8" TYPE X GYPSUM BD. ON BOTH SIDES
FIRE RESISTANCE RATING: 1HR.
SOUND TRANSMISSION CLASS (STC): 51

SECTION

REVISED 01/11/2021

HIBERNIA ST.

